


TOP VIEW

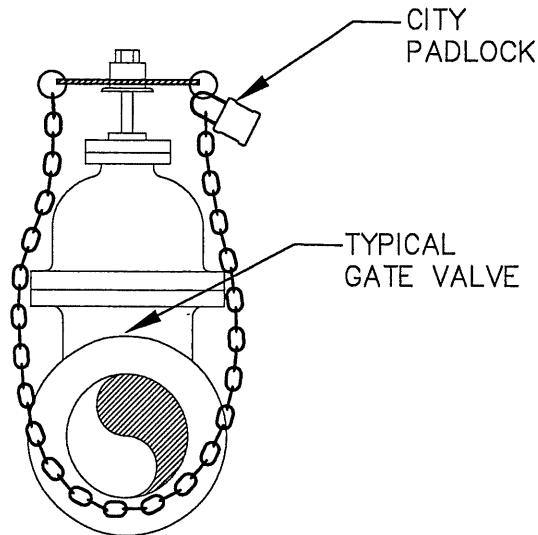

SIDE VIEW

NOTES:

1. UNLESS OTHERWISE REQUIRED BY PUBLIC WORKS, PROVIDE ONE LOCK ASSEMBLY PER VAULT.
2. VALVE LOCK ASSEMBLY TO BE HOT DIP GALVANIZED AFTER FABRICATION.

LAST REVISION DATE: JULY 2015	JO #
WATER METER VAULT BYPASS VALVE LOCK	
(NTS)	
SILVERTON, OR	DETAIL NO. 527